



Sheet 88 of 108/10

THE PORT AUTHORITY
OF NY & NJ



ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (J.R. L.)

**Joseph R. Loring
& Associates, Inc.**
consulting engineers
One Pennsylvania Plaza
New York, New York 10001-2245
Tel: (212) 512-7400, Fax: (212) 512-7382

THE OFFICE OF
**DAVID
ELLIOT
LEBOWITZ
P.C.**
ARCHITECTS - PLANNERS
110 WEST 40TH STREET, NEW YORK, NY 10018
TEL: (212) 693-1234 FAX: (212) 693-1235

**LESLIE E. ROBERTSON
ASSOCIATES, R.L.L.P.**
CONSULTING STRUCTURAL ENGINEERS
25 EAST 40TH STREET
NEW YORK, NY 10018
TEL: (212) 693-1234 FAX: (212) 693-1235


I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT
COPY OF ONE OF THE CONTRACT DRAWINGS CON-
STITUTING A PART OF CONTRACT NO. **WTC-945.071**
IN THE FORM IN WHICH SAID DRAWINGS WERE
THE TIME THE SAID CONTRACT WAS EXECUTED BY
THE PARTIES.
DATE **11/16/98** *Stephen A. Nelson*
DATE **11/16/98** *PK*
ENGINEER OF DESIGN

No.	Date	Revision	Approved
11/17/97		ISSUED FOR BID	
		Engineering Department	
		Design Divisions	
		The World Trade Center	

Title
**STANDBY POWER
5 WORLD TRADE CENTER
FIRE PROTECTION
5 WTC PART PLAN
FUEL OIL TANK ROOM**

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

VP	M.A.R.	VP
Drawn by	Drawn by	Check by
Date	Date	Date
11/17/97	11/17/97	11/17/97
Contract Number	Contract Number	Contract Number
WTC-945.071	WTC-945.071	WTC-945.071
Drawing Number	Drawing Number	Drawing Number
FP-01	FP-01	FP-01

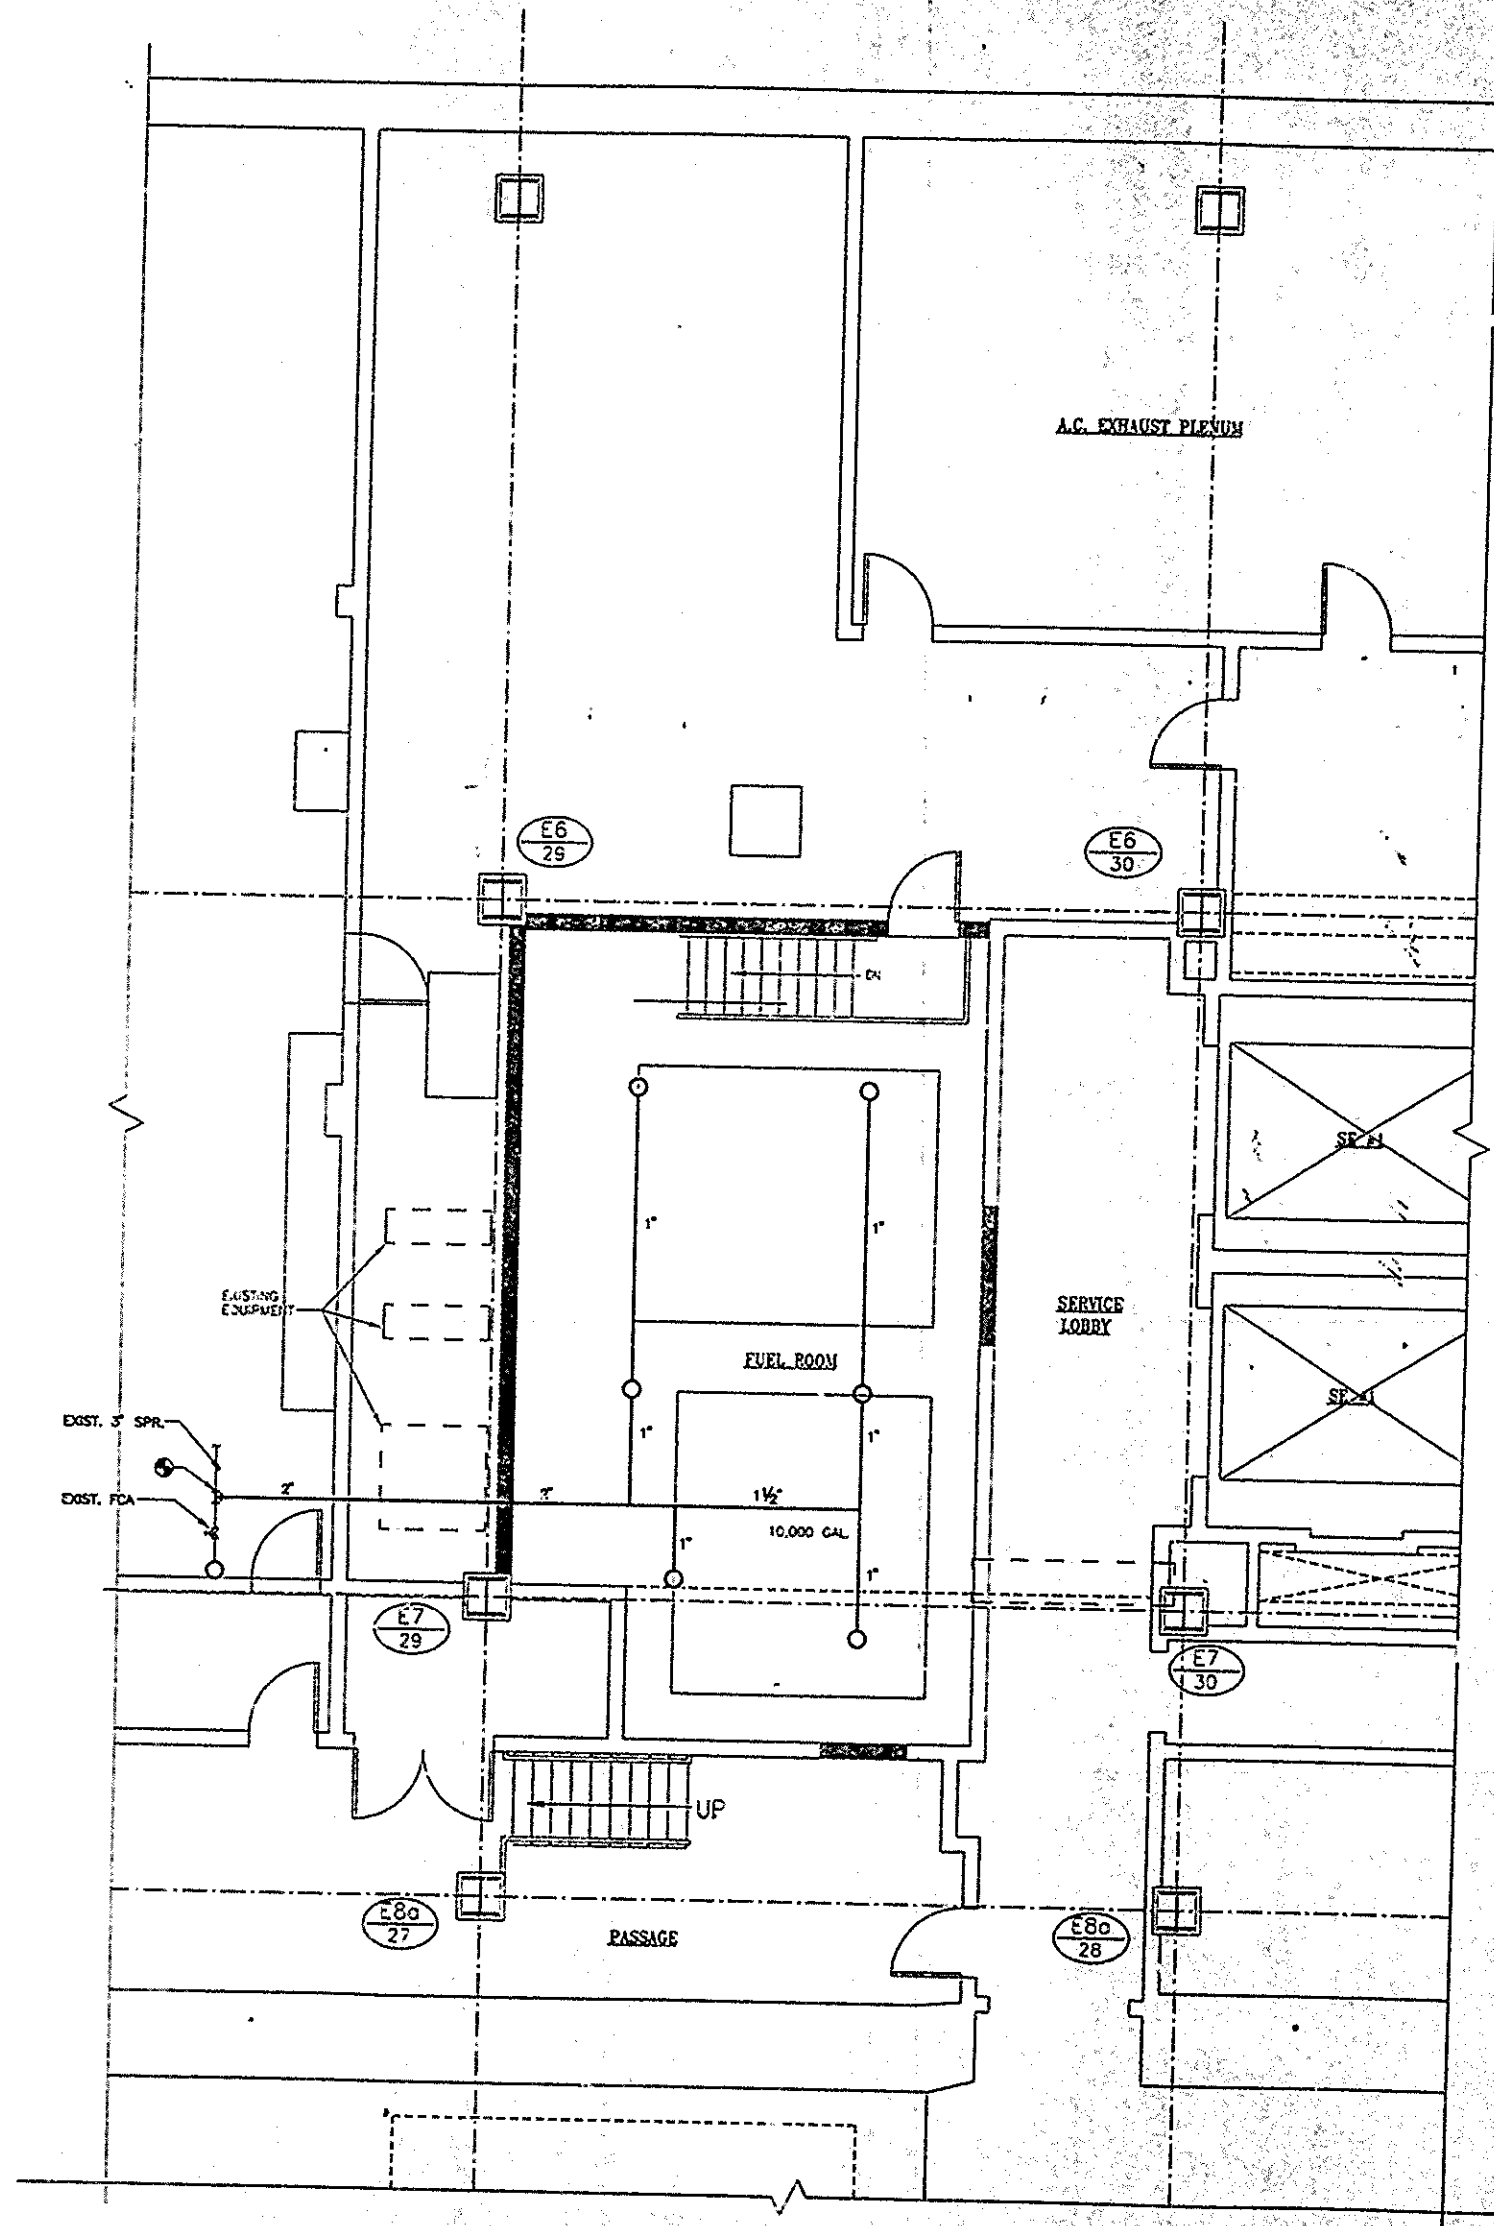

NOTE:
LOCATE SPRINKLER DEFLECTORS MIN. OF 1" &
MAX. OF 6" BELOW BOTTOM OF 12" STEEL BEAMS

**5 WTC PART PLAN B2 LEVEL
FUEL OIL TANK ROOM**

